

Development of Interisland Freshwater Supply System with Micro Hydropower System

by Tri Suyono

Submission date: 19-Mar-2024 03:49PM (UTC+0700)

Submission ID: 2324622990

File name: CEA31-14826490.pdf (762.67K)

Word count: 3928

Character count: 20907

Development of Interisland Freshwater Supply System with Micro Hydropower System

Tri Suyono^{1,2,*}, Agustinus Purna Irawan², Wati Asriningsih Pranoto², Kifli Umar¹, Witono Hardi¹, Said Hi Abbas¹, Ahmad Fudholi^{3,4}

¹Faculty of Engineering, Universitas Khairun, Gambesi Street, South Ternate, North Maluku, Indonesia

²Department of Civil Engineering, Universitas Tarumanagara, Jakarta, Indonesia

³Solar Energy Research Institute, Universiti Kebangsaan Malaysia, 43600, Selangor, Malaysia

⁴Research Center for Energy Conversion and Conservation, National Research and Innovation Agency (BRIN), Indonesia

⁴Received January 13, 2022; Revised May 11, 2022; Accepted June 21, 2022

Cite This Paper in the Following Citation Styles

(a): [1] Tri Suyono, Agustinus Purna Irawan, Wati Asriningsih Pranoto, Kifli Umar, Witono Hardi, Said Hi Abbas, Ahmad Fudholi, "Development of Interisland Freshwater Supply System with Micro Hydropower System," *Civil Engineering and Architecture*, Vol. 11, No. 1, pp. 395 - 400, 2023. DOI: 10.13189/cea.2023.110131.

(b): Tri Suyono, Agustinus Purna Irawan, Wati Asriningsih Pranoto, Kifli Umar, Witono Hardi, Said Hi Abbas, Ahmad Fudholi (2023). Development of Interisland Freshwater Supply System with Micro Hydropower System. *Civil Engineering and Architecture*, 11(1), 395 - 400. DOI: 10.13189/cea.2023.110131.

Copyright©2023 by authors, all rights reserved. Authors agree that this article remains permanently open access under the terms of the Creative Commons Attribution License 4.0 International License

Abstract The supply of freshwater must be conducted with considerable technical considerations based on community socioeconomic conditions. Thus, the supply of freshwater does not make the community oppose the operation and maintenance. Limbo Island is one of the islands that do not have freshwater potential; hence, people have to fetch water from Taliabu Island, which is about 3 nautical miles away. For this reason, providing freshwater with environmentally friendly technology is necessary. Given technical and operational considerations, the drinking water supply in Limbo Island comprises a system of underwater pipelines with electrical technologies and energy sources that are environmentally friendly and have low operational costs. The system does not require an operator with expertise or special education, such that it can be operated by locals. The supply of freshwater for Limbo Island is constructed with an underwater piping system with a capacity of 30 L/s to serve some of the people of Taliabu and Limbo Islands. The pipe used for crossing the sea is high density polyethylene (HDPE) pipe with a diameter of 110 mm and a nominal pressure specification of 20 bar; it has a thickness of 12 mm, with two pipes with a length of 5,800 m at the bottom of the sea. The flow system in the transmission and distribution pipe is run by gravity; thus, it does not require electrical energy. Electrical energy requirements are used for water treatment processes, such as for drive dosing pumps, mixers,

compressors for pneumatic systems, lighting and other electrical needs. These requirements are met by the water energy that is processed through a micro hydropower of 12.5 kW. Micro hydropower strongly supports the operation of the water treatment plant, especially for those whose location is far from access to electrical energy by the electricity company, so that the water treatment plant operations can be carried out continuously and the operating costs are cheaper.

Keywords Micro Hydropower, Freshwater, Water Treatment, Electrical Energy, Underwater Pipeline

1. Introduction

The provision of drinking water must consider various aspects, including technology, energy use and operational and maintenance costs [1-3]. The use of technology and energy must be adjusted to the potential of human resources, supporting facilities, such as energy, and the capacity of the community, such that the constructed water supply system can function properly. The use of high technology with high energy consumption will result in expensive water prices, which is suitable for high-income people who are mostly in urban areas [4,5]. However, areas

where people's income is still low need the application of technology and energy sources whose water production costs are affordable for the community.

In regions in Indonesia, such as North Maluku, a few uninhabited islands, such as Limbo, Maitara, Hiri, Kayoa and Gala Islands, have no source of clean or drinking water; thus, the water supply in these regions needs technology that can serve the needs of the community continuously, in terms of capacity and quality at an affordable price [6,7]. In meeting water needs, including washing and bathing, people have to go to the nearest island by crossing the sea, which is extremely difficult if the sea weather is not good. The community will be helped slightly during the rainy season because they can use rainwater to meet their freshwater needs [8-10].

Drinking water in areas such as Limbo Island must be provided by selecting the right technology and in accordance with regional conditions, such that the water supply system can function properly. The choice of expensive and sophisticated technology will result in high investment, operational and maintenance costs, thereby making the water production costs high. This condition will considerably affect water services to the community if implemented on Limbo Island, because water services to rural communities with small incomes cannot always be performed for business purposes. Thus, technology and energy with low operational and maintenance costs are needed. In addition, energy availability, especially in remote areas, is also limited [11-13]. Limbo Island is a small island that is about 3 nautical miles from Taliabu Island, North Maluku, Indonesia; it does not have the potential for sufficient freshwater to meet the needs of the community, so people have to fetch water from Beringin river, Taliabu Island by boat [14]. This condition makes the price of water on this island expensive due to the need for fuel costs and risks when the sea weather is not good. Hence, providing drinking water that is cheap and easily accessible is necessary. From the conditions mentioned above, technology with environmentally friendly energy must be utilised to ensure the continuity of drinking water services on these islands. The technology must prioritise systems based on gravity in terms of transmission and distribution, including the provision of electrical energy for the water treatment process [15-17]. One of the

technologies applied in the freshwater supply in islands that do not have freshwater is by means of underwater pipeline. Such application is conducted based on technical studies. Figure 1 shows people on Limbo Island taking water, bathing and washing clothes in the Beringin river Taliabu Island. they come to this island regularly every 2-3 days by boat.

2. Technology of Freshwater Supply

Water on Limbo Island is provided using submarine pipeline technology with water from the Beringin River. The intake building is at an elevation of 132 m on the sea level, the water treatment plant has a capacity of 30 L/s at an elevation of 113 m on the sea level and the Taliabu Island reservoir has a capacity of 500 m³ at an elevation of 51 m on the sea level. From this water treatment installation, two pipelines are divided: one pipe to the community housing on Taliabu Island (Salati, One Way and Nggele Villages), and the other pipe goes to Beringin Jaya Village and continues to Limbo Island by sea in the Limbo Strait with a depth of between 0 m and 47 m. Limbo Island, a reservoir with a capacity of 150 m³ is constructed at an elevation of 19 m on the sea level to serve residential houses at an elevation between 1 m and 6 m on the sea level, with a pipe length of approximately 2 km. With this system, all of the transmission and distribution pipelines can be streamered by the gravity system. The electrical energy in water treatment plants is supplied by micro hydropower that utilises the remaining water pressure from the intake to the water treatment plant (WTP), that is, an high density polyethylene (HDPE) pipe with a diameter of 250 mm length of 1,800 m and height difference of 74 m As shown in Figure 2, the schematic of the underwater drinking water pipe from Taliabu Island to Limbo Island.

The water supply utilises environmentally friendly technology, which is classified as green technology; such technology is used in the water flow system in the transmission and distribution pipes, all of which are gravity and do not use fossil fuels as an energy source [18-20]. In the water treatment plant, conventional WTP is used, which operates with the flowing fluid and also does not require electrical energy to pump water.



Figure 1. People of Limbo Island washing clothes, bathing and taking water from Beringin River on Taliabu Island

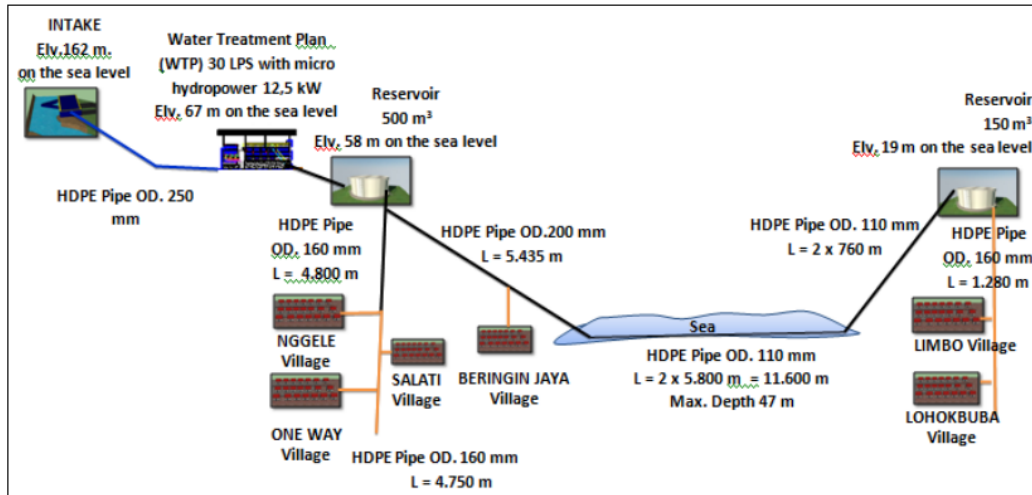


Figure 2. Schematic of underwater pipeline from Taliabu Island to Limbo Island

Table 1. Material properties of HDPE pipe

No	Property	Value	Units
1	Density	959	kg/m ³
2	Modulus of elasticity	1250	MPa (N/mm ²)
3	Modulus of sliding	481	MPa (N/mm ²)
4	Diameter of outside	110	mm
5	Diameter of inside	86	mm
6	The wall thickness of the pipe	12	mm
7	Standard Dimension Ratio (SDR)	11	
8	Tensile strength at yield	26	MPa (N/mm ²)
9	Tensile strength at break	35	MPa (N/mm ²)
10	Maximum pressure from inside	2,0	MPa (N/mm ²)

With a sea depth of 47 m and a reservoir height at the location of the water treatment plant at 51 m above sea level, the water level difference in the deepest pipe is 98 m. To WTP the water hammer that can occur when the water stops flowing suddenly, which can cause a pressure twice the normal pressure of water in the pipe, a pipe with a nominal pressure of 20 bar is selected. Table 1 presents the detailed the specifications of the selected pipe.



Figure 3. Freshwater pipeline on the seabed of Limbo Strait

3. Dimensions and Specifications of Pipes

Calculating the dimensions of the pipe start from analysis the population in the projection year at least 20 years from now and the water needs of 0.15 m³/person/day. The pipe dimensions are calculated as follows:

$$ID = \sqrt{\left[\left(\frac{\sum p \times W_d \times 4}{86400} \right) \times 3.14 \right]}$$

where ID is the pipe diameter (mm), $\sum p$ is the total population in the projection year (person) and W_d is the water needs (m³/person/day). Then,

$$ID = \sqrt{\left[\left(\frac{3946 \times 0.15 \times 4}{86400} \right) \times 3.14 \right]} = 0.086 \text{ m} = 86 \text{ mm}$$

The specifications of the HDPE pipeline will be referenced in the technical analysis of subsea pipelines. The HDPE pipe is selected for its several advantages [21-24]: (i) it does not corrode, so it lasts long in water; (ii) it has good elasticity, such that it can lie following the contours of the seabed; (iii) it is easy to maintain in case of break or buckling; (iv) its light weight makes it easy to transport and install; (v) its connection process is easy and possible to do with vessels of 5–20 GT size; and (vi) its price is cheaper than steel pipe.

The disadvantage of the HDPE pipe is that its density is smaller than sea water; thus, it takes a larger additional

period to submerge than steel pipes. The pipe is installed lying on the seabed, such that it is more stable, and over time, it will be buried in sand [25-27]. The ballast concrete will also be overgrown with coral reefs; thus, it can become a new home for marine animals [28-31]. Figure 3 shows adjacent pipes installed for easy maintenance and leak detection.

4. Provision of Energy

Electrical energy is needed in water treatment plants for the drive mixers, dosing pumps, compressors for pneumatic systems, lighting and energy needs for operators [32,33]. The energy required in water treatment plants is between 7 kW and 10 kW, which can be provided by utilising water energy on the ends of the transmission pipe. The potential energy in a water treatment plant is calculated as follows:

$$P = Q \cdot H \cdot g \cdot \eta_{mh} \text{ (kW)}$$

Where P is the micro hydro output power (kW), Q is the capacity of water entering the turbine (m^3/s), H is 12 head (difference in height minus losses), g is the acceleration due to gravity (9.81 m/s^2) and η_{mh} is the efficiency of the total micro hydropower (0.65; calculated based on eff. turbine, e₂ axis and eff. generator).

The intake building is at an elevation of 132 m. on the sea level altitude at V note WTP 58 m. on the sea level, a distance of 1,800 m and an estimated head loss of 8 m. The remaining head is calculated as follows:

$$H = 132 \text{ m} - (58 + 8 \text{ m}) = 66 \text{ m};$$

and if the discharge/intake water capacity is $30 \text{ L/s} = 0.03 \text{ m}^3/\text{s}$, then,

$$P = 0.03 \times 66 \times 9.81 \times 0.65 = 12.6 \text{ kW}$$

The calculation results show that the installation of micro-hydro at the transmission pipe unit by utilizing water energy before entering the water treatment plant can meet the WTP's electrical energy needs which consist of a chemical system (compressors for pneumatic systems, lighting and other electrical needs). With the installation of micro-hydro, the energy used in this system is environmentally friendly (green energy). In this development, a micro-hydro power plant of 12.5 kW is sufficient for electricity needs at the water treatment plant, so that it can be used for lighting around buildings and access roads. The installed micro hydropower is shown in Figure 4. The micro hydro is installed at the bottom by utilizing the water pressure from the intake before entering the WTP. The micro hydro position does not interfere with the WTP work system, in fact it is very supportive in providing cheap and environmentally friendly electrical energy sources, so this technology is very effective to apply.



Figure 4. Micro-hydro installed in water treatment plants



Figure 5. People rushing to collect water at the end of an overflow reservoir pipe

5. Water Distribution

Water is distributed through pipes directly to people's homes and for public services, namely schools, ports, sports fields and places where there are many people's activities [34-36]. With the availability of fresh water in their home environment, the community is very enthusiastic because they no longer need to take water from big islands by boat which requires fuel and risks life safety, especially in the wind and wave season. In Figure 5 it can be seen the excitement of the community when taking water alternately in the over flow pipe section. The fresh water distribution system on Limbo Island is also gravitational so that there is no electricity cost for the pump, this really helps the community in minimizing the operational and maintenance costs of distribution pipes [37-39]. The position of the reservoir which has a capacity of 150 m³ and is located at an altitude of 19 meters above sea level is also sufficient to provide water pressure for the distribution process by gravity. The water pressure in the farthest pipe is more than 0.5 bar.

6. Conclusions

The selection of inter-island subsea pipeline technology for the supply of fresh water on the island of Limbo was carried out with various considerations, which prioritized operational costs, availability of technology, energy and professional operators at the construction site. The type of pipe used is HDPE pipe with a diameter of 110 mm and a nominal pressure of 20 bar whose specifications are selected based on the calculation of fresh water requirements, hydraulic calculations and the strength of the pipe to withstand various forces and environments on the seabed. This type of pipe is also safer from corrosion so it does not require special treatment. The distribution of fresh water using underwater technology from Taliabu Island to Limbo Island is carried out by gravity so that in this design there is no electricity cost for the water pump. This technology system is also equipped with conventional technology water treatment plants, all of which operate by gravity or without a pump. The electricity requirement for water treatment plants (WTP) is only for chemical systems and lighting provided by installing a micro-hydro with a power of 12.5 kW. The energy produced by micro hydro is obtained from water energy in the transmission pipe which is installed before the water enters the WTP with a capacity of 30 lps. With this system, the community can obtain good quality fresh water at affordable production costs. This technology can really benefit the people on Taliabu Island and Limbo Island. This technology can also be applied in other areas that have the same potential, so that it can help provide fresh water on islands that do not have fresh water potential.

REFERENCES

- [1] Arcipowski, E., Schwartz, J., Davenport, L., Hayes, M., Nolan, T. 2017. Clean Water, Clean Life: Promoting Healthier, Accessible Water in Rural Appalachia. *Journal of Contemporary Water Research & Education*, 161:1-18.
- [2] Brennan, M. K., Karimi, M., Almeida, F. C. L., de Lima, F. K., Ayala, P. C., Obata, D., Paschoalini, A. T., Kessissoglou, N. 2017. On the Role of Vibro-Acoustics in Leak Detection for Plastic Water Distribution Pipes. *Procedia Engineering* 199: 1350-1355.
- [3] Brennan, M. K., Karimi, M., Almeida, F. C. L., Almeida, F. C. L., de Lima, F. K., Ayala, P. C., Obata, D., Paschoalini, A. T., Kessissoglou, N. 2018. On the Effects of Soil Properties on Leak Noise Propagation in Plastic Water Distribution Pipes.
- [4] Dey, S., Singh, N. P. 2007. Clear-Water Scour Depth Below Underwater Pipelines. *Journal of Hydro-environment Research* 1:157-162.
- [5] Ghernaout, D. 2017. Increasing Trends Towards Drinking Water Reclamation from Treated Wastewater. *World Journal of Applied Chemistry*, 3(1): 1-9.
- [6] Hardi, W., Suyono, T. 2016. Teknik Pemasangan PWTP Air Minum Bawah Laut dengan Metode TT dari Pulau Tidore ke Pulau Maitara. *Semnas Maritim, Sains dan Teknologi Terapan*, Vol. 01. ISSN: 2548-1509.
- [7] Pranoto, W. A., Suyono, T. 2018. Stability Analysis of Underwater Pipeline Inter Island for Drinking Water. *Atlantis Highlights in Engineering*, vol. 1, ICST.
- [8] Suyono, Tri, Asriningsih Pranoto, Wati, Purna Irawan, Agustinus. 2019. Peer Review: Hydraulic analysis of drinking water pipeline inter island. *TICATE 2018*. ISSN 1757899X.
- [9] Suyono, Tri, Purna Irawan, Agustinus, Asriningsih Pranoto, Wati and Fudholi, Ahmad. 2020. Comparison Between Suspended or Seabed Pipeline Installation for Inter Island Fresh Water System. *ARPN Journal of Engineering and Applied Sciences*, 15 (7). pp. 862-866. ISSN 1819-6608.
- [10] Suyono, T. Pranoto, W. A., Irawan, A. P. Hydraulic Analysis of Drinking Water Pipeline Inter Island. 1st Tarumanagara International Conference on the Applications of Technology and Engineering (TICATE 2018). Jakarta, 22-23 November 2018.
- [11] Suyono, T., Irawan, A. P., Pranoto, W. A. 2019. Repair Techniques in Underwater Pipelines for Drinking Water. 1st Tarumanagara International Conference on the Applications of Technology and Engineering (TICATE 2018). Jakarta, 22-23 November 2018.
- [12] Muchlis, Pranoto, W. A., Suyono, T. Concept of Sediment Filtration Intake Design for Raw Water Drinking Water. 1st Tarumanagara International Conference on the Applications of Technology and Engineering (TICATE 2018). Jakarta, 22-23 November 2018.
- [13] Pranoto, W. A., Suyono, T. 2020. Ground Water Potential Analysis in Saolat and Waijoi Area East Halmahera. *IOP Conf. Ser: Mater. Sci. Eng.*
- [14] Pranoto, W. A., Suyono, T. 2020. Potential Study of Ground Water Lembah Keramat Tidore Island. 1st Tarumanagara International Conference on the Applications of Technology and Engineering (TICATE 2018). Jakarta, 22-23 November 2018.
- [15] Suyono, T., Latif, L. A. 2018. Analysis of Potential Micro hydro for Water Treatment Plant. *Atlantis Highlights in Engineering*, vol. 1, ICST.
- [16] Abidin, Z. 2008. Analisis On-Bottom Stability dan Instalasi PWTP Bawah Laut di Daerah Shore Approach. *Skripsi. Fakultas Teknik Sipil dan Lingkungan, Institut Teknologi Bandung.*
- [17] Sibue, C. Mulyadi, Y., Rochani, I. 2016. Analisis On-Bottom Stability dan Local Buckling: Studi Kasus PWTP Bawah Laut dari Platform Ula Menuju Platform Uw. *Jurnal Teknik ITS*, Vol. 5, No. 2. ISSN: 2337-3539.
- [18] Cheung, B. C., Carriveau, R., Ting, D. S. K. 2014. Parameters Affecting Scalable Underwater Compressed Air Energy Storage. *Applied Energy* 134: 239-247.
- [19] Guo, B., Song, Shanhong, Ghalambor, A., Lin, T., Chacko, J. 2005. *Offshore Pipelines*, 1st Edition. Gulf Professional Publishing. ISBN: 9780080456904.
- [20] Kiziloz, B., Cevik, E., Yuksel, Y. 2013. Scour Below

- Submarine Pipelines Under Irregular Wave Attack. *Coastal Engineering* 79, 1-8.
- [21] Lee, E. J., Schwab, K. J. 2005. Deficiencies in drinking water distribution systems in developing countries. *Journal of Water and Health*.
- [22] Cheng, L., Yeow, K., Zang, Z., Lie, F. 2014. 3D Scour Below Pipelines Under Waves and Combined Waves and Currents. *Coastal Engineering* 83: 137-149.
- [23] Hajibabaei, M., Nazif, S., Tavanaei, F., 2018. Life Cycle Assessment of Pipes and Piping Process in Drinking Water Distribution Networks to Reduce Environmental Impact. *Sustainable Cities and Society*.
- [24] Carrard, N., Foster, T., Willetts, J. 2019. Groundwater as a Source of Drinking Water in Southeast Asia and the Pacific: A Multi-Country Review of Current Reliance and Resource Concerns. *Water*, 11.
- [25] Supena, M. 2011. Perancangan Jaringan PWTP Transmisi Gas dari Labuhan Mringgai ke Muara Bekasi melalui Jalur Lepas Pantai. Skripsi. Fakultas Teknik, Universitas Indonesia.
- [26] Hernaningsih, T., 2015. Perancangan Pilot Plant Pengolahan Air Minum untuk Zona Pendidikan dan Riset Kawasan Techno Park, Kabupaten Palalawan. *JAI*, Vol 8, No. 2.
- [27] Li, X., Chen, G., Zhang, R., Zhu, H., Fu, J. 2018. Simulation and Assessment of Underwater Gas Release and Dispersion from Subsea Gas Pipelines Leak. *Process Safety and Environmental Protection* 19: 46-57.
- [28] Ibrahim, M., Masrevaniah, A., Dermawan, V. 2012. Analisa Hidrolis pada Komponen Sistem Distribusi Air Bersih dengan Waternet dan Watercad Versi 8 (Studi Kasus Kampung Digiouwa, Kampung Mawa dan Kampung Ikebo, Distrik Kamu, Kabupaten Dogiyai). *Jurnal Pengairan, Universitas Brawijaya*.
- [29] Lock, A., Spiers, G., Hostetler, B., Ray, J., Wallschlager, D. 2016. Multi-Dimensional Water Quality Assessment of an Urban Drinking Water Source Elucidated by High Resolution Underwater Towed Vehicle Mapping. *Water Research* 93: 289-295.
- [30] Rhoads, W. J., Pruden, A., Edwards, M. A. 2015. Survey of green building water systems reveals elevated water age and water quality concerns. *Environmental Science Water Research and Technology*, 2:164.
- [31] Rizzini, D. L., Kallasi, F., Aleotti, J., Oleari, F., Caselli, S. 2017. Integration of a Stereo Vision System into an Autonomous Underwater Vehicle for Pipe Manipulation Tasks.
- [32] Lutterbeck, C. A., Kist, L. T., Lopez, D. R., Zerwes, F. V., Machado, E. L. 2017. Life cycle assessment of integrated wastewater treatment systems with constructed wetlands in rural areas. *Journal of Cleaner Production* 148: 527-536.
- [33] Shamsuddoha, Md., Islam, Md. M., Aravinthan, T., Manalo, A., Lau, K. 2013. Effectiveness of Using Fbre-reinforced Polymer Composites for Underwater Steel Pipeline Repairs. *Composite Structures* 100: 40-54.
- [34] Yan, W., Li, J., Bai, X. 2016. Comprehensive Assessment and Visualized Monitoring of Urban Drinking Water Quality. *Chemometrics and Intelligent Laboratory Systems* 155:26-35.
- [35] Simetti, E., Csalino, G., Wanderlingh, F., Aicardi, M. 2018. Task Priority Control of Underwater Intervention Systems: Theory and Applications. *Ocean Engineering* 164: 40-54.
- [36] Wang, Z., Xiong, W., Ting, D. S. K., Carriveau, R., Wang, Z. 2016. Conventional and Advanced Exergy Analyses of an Underwater Compressed Air Energy Storage System. *Applied Energy* 180: 810-822.
- [37] Wang, Y. G., Liao, C. C., Wang, J. H., Jeng, D. S. 2018. Dynamic Response of Pipelines with Various Burial Depth Due to Underwater Explosion. *Ocean Engineering* 164: 114-126.
- [38] Yang, L., Nie, S., Yin, S., Zhao, J. Yin, F. 2015. Numerical and Experimental Investigation on Torque Characteristics of Seawater Hydraulic Axial Piston Motor for Underwater Tool System. *Ocean Engineering* 104:168-184.
- [39] Zhu, H., You, J., Zhao, H. 2017. Underwater Spreading and Surface Drifting of Oil Spilled from a Submarine Pipeline Under the Combined Action of Wave and Current. *Applied Ocean Research* 64:217-235.

Development of Interisland Freshwater Supply System with Micro Hydropower System

ORIGINALITY REPORT

7%

SIMILARITY INDEX

7%

INTERNET SOURCES

3%

PUBLICATIONS

%

STUDENT PAPERS

PRIMARY SOURCES

1

repository.effatuniversity.edu.sa

Internet Source

2%

2

repository.untar.ac.id

Internet Source

1%

3

pubmed.ncbi.nlm.nih.gov

Internet Source

1%

4

www.hrpub.org

Internet Source

1%

5

Wati Asriningsih Pranoto, Tri Suyono. "Ground Water Potencial Analisis in Saolat And Waijoi Area East Halmahera", IOP Conference Series: Materials Science and Engineering, 2020

Publication

<1%

6

"Proceedings of the Second International Conference of Construction, Infrastructure, and Materials", Springer Science and Business Media LLC, 2022

Publication

<1%

7	123dok.com Internet Source	<1 %
8	etheses.whiterose.ac.uk Internet Source	<1 %
9	www.atlantis-press.com Internet Source	<1 %
10	coek.info Internet Source	<1 %
11	ijcst.trunojoyo.ac.id Internet Source	<1 %
12	journal.irpi.or.id Internet Source	<1 %
13	open.library.ubc.ca Internet Source	<1 %

Exclude quotes On

Exclude matches Off

Exclude bibliography On